

Multi-Objective Optimization of Run-of-River Small Hydro-PV Hybrid Power Systems

Amèdédjihundé H. J. Hounnou
Department of Electrical Engineering
& Département ÉNERGIE.
Polytechnic School of Abomey-Calavi.
University of Abomey-Calavi.
& FEMTO-ST, CNRS, Univ. Bourgogne
Franche-Comté.
Abomey-Calavi, Benin
& F90000 Belfort, France.
jorhyam@yahoo.fr

Frédéric Dubas
Département ÉNERGIE, FEMTO-ST, CNRS,
Univ. Bourgogne Franche-Comté
F90000 Belfort, France.
FDubas@gmail.com

François-Xavier Fifatin
Department of Electrical Engineering,
Polytechnic School of Abomey-Calavi.
University of Abomey-Calavi.
Abomey-Calavi, Benin.
fxfifatin@yahoo.fr

Maurel Aza-Gnandji
Department of Electrical Engineering,
Polytechnic School of Abomey-Calavi.
University of Abomey-Calavi.
Abomey-Calavi, Benin.
maurel.aza@gmail.com

Didier Chamagne
Département ÉNERGIE, FEMTO-ST, CNRS,
Univ. Bourgogne Franche-Comté
F90000 Belfort, France.
didier.chamagne@univ-fcomte.fr

Antoine Vianou
Department of Electrical Engineering,
Polytechnic School of Abomey-Calavi.
University of Abomey-Calavi.
Abomey-Calavi, Benin.
avianou@yahoo.fr

Abstract—This paper presents the sizing of run-of-river small hydro-PV hybrid power system using the Non-dominated Sorting Genetic Algorithm (NSGA-II). The two objective functions are the total generated energy and the energy production cost of hybrid system. The total energy has been maximized whereas the energy production cost of hybrid system has been minimized. The nominal turbine flow rate (Q_{Tr}), the number of hydropower units (n_{hyd}), and the number of PV modules (n_{pv}) are considered as decision variables in this problem. The Yeripao site in Benin has been considered as case study. The optimal solutions converge to Pareto front which represent the best trade-offs between total generated energy and energy production cost. The results have shown that energy production cost increases with the total generated energy. Thus, minimizing the energy production cost is contradictory with maximizing the total generated energy. Moreover, the sensitivities analysis of Q_{Tr} and n_{hyd} on the total generated energy and on energy production cost have been conducted in this study. It is relevant to note that the optimal solutions are grouped into four categories according to $n_{hyd} = 1, 2, 3$ or 4 . For each category, the total generated energies, energy production costs and cost per kWh increase with the Q_{Tr} . For $n_{hyd} = 1$ the lowest values of energy production costs, total generated energies and costs per kWh have been recorded. Moreover, $n_{hyd} = 4$ match with the solutions that present the highest total generated energies and costs. The lowest overall cost per kWh is € 0.363/kWh. The conducted study can be applied to other sites by using their hydro and solar resources characteristics.

Keywords—cost, energy generation, hydro-PV hybrid system, multi-objective optimization

I. INTRODUCTION

Hybrid power plants are becoming increasingly attractive owing to their most efficiency. They are technically and economically approved in diverse cases. Existing hybrid systems are generally composed of hydro-PV system [1]–[4], wind-PV system [5], [6], hydro-wind system [7], [8], hydro-PV-wind system [9], [10], and hydro-PV-wind-Diesel system

[11], [12]. Hydro-PV systems are becoming more and more popular among these diverse hybrid systems, because of the low costs and operational flexibility of hydropower plants [13]. Moreover, the solar energy is highly available on all world. Studies addressing on hydro-PV plants are mainly focus on complementarity analysis between two power sources [14]–[18]. Beluco *et al.* [14] evaluated the complementarity effect between solar and hydro energy concluding that the determination of complementarity characteristics were required for designing the hybrid power system and could improve efficiency of the system. Kougiass *et al.* [16] presented a methodology to improve the time complementarity between solar PV systems and small hydropower plants. François *et al.* [17] analyzed the complementarity between run-of-river energy and solar in Northern Italy. They noted that the system stability was improved by hydropower at small temporal scale (hourly) and by solar power generation at larger temporal scales (daily and monthly). François *et al.* [15] predicted complementarity between PV and run-of-river hydropower by studying the skill of different hydrological prediction methods. Li *et al.* [18] used long-term stochastic optimization approaches to improve the performance of long-term complementary operation for a large-scale hydro-PV hybrid power plant. The operations management of hydro-PV hybrid power system are discussed in other papers. Sheng *et al.* [19] analyzed operation characteristics of small hydro-PV hybrid power system and proposed control strategies to maintain balance between generations and loads. Yang *et al.* [20] designed parallel and interactive operation modes for hydro-PV hybrid power system. Zhou *et al.* [21] focused their study on the stability of the hydro-PV hybrid power system by using a PSCAD simulation. Meshram *et al.* presented simulation modeling of PV-hydro hybrid power system connected to grid [22], analysed the system and noted that it could feed the community [23]. The authors also studied the power management strategy and the performance analysis of the system for determining the active power dispatching [24]. Wei *et al.* [25] proposed frequency restoring method to control output active power of hydro-PV hybrid system. Rezkallah *et*

al. [26] proposed control algorithm for regulating voltage and frequency and extracting the maximum power from standalone micro hydro-PV hybrid system. An *et al.* [27] described the principle of hydro-PV hybrid system operation and concluded that hydropower could improve the power quality of PV system in short-term scheduling and PV system could compensate the hydropower energy in mid- to long-term scheduling and during peak load periods. Li *et al.* [28] developed a multi-objective optimization model for hydro-PV hybrid system, while considering the power regularity and the total annual power generated by the system as objective functions. The authors used NSGA-II for optimizing the multi-objective problem. Jena *et al.* [29] used a Fuzzy Controlled STATCOM to improve the voltage and frequency stabilization in a micro hydro-PV-battery hybrid system. Jurasz *et al.* [30] maximized the energy and controlled the variability of run-of-river PV hybrid power plants by using mixed integer mathematical programming. The dynamic programming method has been used in [31] for optimizing the long-term operating of hydro-PV hybrid power system in China's Longyangxia. The study's objectives were to maximize the total produced energy and system reliability simultaneously. Reddy [32] applied constant current controller to supervise the hydro-PV hybrid power plants. Das *et al.* [33] presented an overall control strategy for the power management from isolated micro hydro-PV-battery hybrid system. Liu *et al.* [34] developed a multi-objective approach for optimal integration of hydro-PV hybrid power systems. The goals of their study were to maximize total power output and minimize the energy balance. Ming *et al.* [35] used three-layer nested approach for improving daily production planning of large hydro-PV power plant. Other studies dressed the size of hydro-PV hybrid power plants [36]–[43]. Glasnovic *et al.* [36] developed simulation-dynamic programming model for optimal sizing of hydro-PV hybrid power system. Mahmoudimehr *et al.* [39] proposed an operational strategy and Genetic Algorithm for optimal designing of PV-hydro hybrid power system by considering loss of power supply probability and investment cost as objective functions. Silvério *et al.* [41] described technical and economical methodologies used for sizing floating PV-hydro hybrid power system. Fang *et al.* [37] optimized the size of hydro-PV hybrid power system by maximizing its net revenue during its lifetime. A model of multi-objective optimization by using NSGA-II was proposed by Li *et al.* [42] for maximizing the total amount of annual energy generation and minimizing the gap between energy demand and supply for hydro-PV hybrid power plant. Ming *et al.* [38] applied cost-benefit analyses to optimize the size of PV-hydro hybrid power plant. Ming *et al.* [43] developed a nesting model for optimal sizing of PV-hydro hybrid power system by minimizing the water consumption of hydro plant when external load requests are imposed to the hybrid system. Kumar *et al.* [40] optimized sizing of hybrid energy system through Particle Swarm Optimization method.

The objective of this paper is to propose a multi-objective optimization method for the optimal sizing of run-of-river small hydro-PV hybrid power system by using NSGA-II as the optimization algorithm. Our interest in this paper is to maximize the total generated energy and minimize the energy production cost, simultaneously. We consider three decision variables such as: the nominal turbine flow rate (Q_{Tr}), the number of hydropower units (n_{hyd}), and number of PV modules (n_{PV}). The best trade-offs between the total

generated energy and the energy production cost of run-of-river small hydro-PV hybrid power system are determined. The influences of Q_{Tr} and n_{hyd} on objective functions are also investigated.

The paper is organized as follow. In Section II, material and methods are presented. Results and discussion are provided in Section III followed by conclusion in Section IV.

II. MATERIAL AND METHODS

A. Simulation Data

The optimization procedure is carried out for hydro and solar resources of Yeripao (latitude: 10°15'21.06" N, longitude: 1°25'43.57" E, altitude: 430 m), which is located in Natitingou, city in northwest of Benin, as shown in Fig. 1. The daily average water flows, global irradiation and ambient temperature over two years (2016-2017) of Yeripao site are shown in Figs. 2-4, respectively. The water flows data of Yeripao river are deduced from data in [44] by using extrapolation method. The global irradiation (G_r) and the ambient temperature (T_a) are obtained from soda site [45]. The profile of load to be satisfied in this study is for a village in rural areas (Fig. 5). This load profile is determined by basing on a similar case which is for rural electrification in developing countries [46].

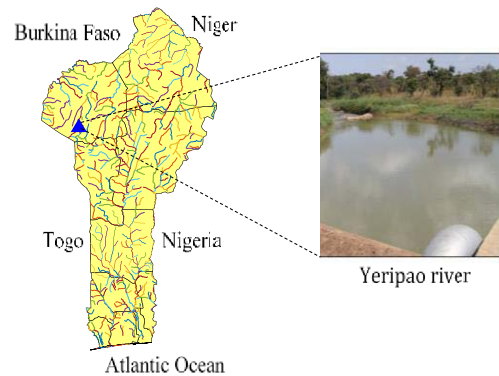


Fig. 1 Location of Yeripao site on hydrological map of Benin.

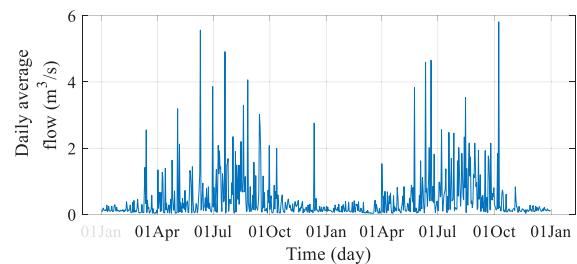


Fig. 2 Daily average water flows over two years (2016-2017) of Yeripao site.

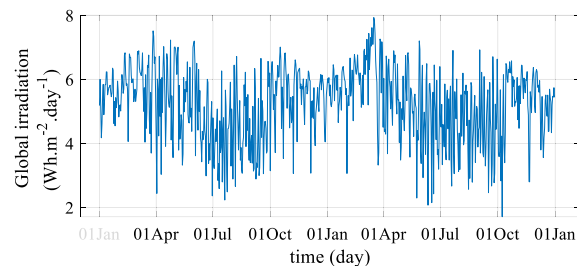


Fig. 3 Global daily irradiation over two years (2016-2017) of Yeripao site.

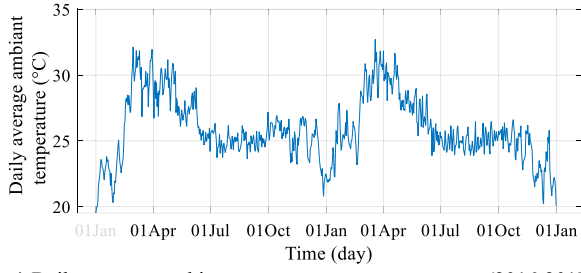


Fig. 4 Daily average ambient temperature over two years (2016-2017) of Yeripao site.

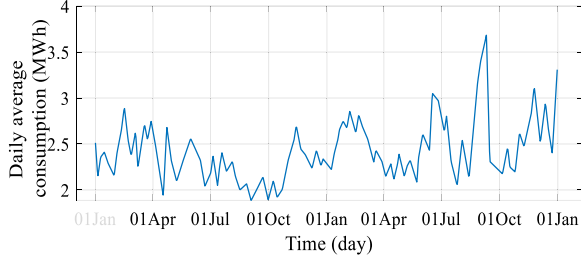


Fig. 5 Profile of daily average energy consumed by a village in rural areas.

B. Model of Energy Generated by Solar Photovoltaic Plant

The energy E_{PV} (1) [kWh] yield of the PV plant over period t [day] depends on energy conversion efficiency of the PV module η_{PV} (2) [%], the global irradiation Gr_{PV} [$kWh \cdot m^{-2} \cdot day^{-1}$], the ambient air temperature T [$^{\circ}C$], the surface area of a PV module A_{PV} [m^2], and the number of PV modules n_{PV} . The PV module which is used in this work is PHOTON SOLAR SC-280P [47].

$$E_{PV}(t) = \eta_{PV}(t) \cdot Gr_{PV}(t) \cdot A_{PV} \cdot n_{PV} \quad (1)$$

The energy conversion efficiency of the module (2) [%] is the product efficiencies due to dust η_{du} , the adaptability of PV modules η_{ad} , the inclination of PV modules η_{in} , Joules in cables η_{jo} , and the temperature η_{tem} .

$$\eta_{PV}(t) = \eta_{du}(t) \cdot \eta_{ad}(t) \cdot \eta_{in}(t) \cdot \eta_{jo}(t) \cdot \eta_{tem}(t) \quad (2)$$

The efficiencies η_{du} , η_{ad} , η_{in} and η_{jo} are respectively estimated at 98%, 96%, 97.3% and 97.8% [48]-[49]. η_{tem} depends on other parameters and expressed by :

$$\eta_{tem}(t) = \eta_{PV_STC} \cdot [1 - \beta \cdot (T_C - 25)] \quad (3)$$

where η_{PV_STC} is the energy conversion efficiency of the PV module (%) defined in STC (viz., air mass (AM) 1.5 and temperature of $25^{\circ}C$), and β is the cell maximum power temperature coefficient (equal to $0.0043^{\circ}C^{-1}$ [47]; it can vary from 0.003 to $0.005^{\circ}C^{-1}$ in crystalline silicon [50]). The cell junction temperature T_C can be determined as follows :

$$T_C(t) = \frac{NOCT - 20}{800} \cdot \frac{G_r(t)}{D_r(t)} + T_a \quad (4)$$

where $NOCT$ is the nominal operating cell temperature and equal to $45^{\circ}C$ [47], and D_r is the sun duration [51].

C. Model of Energy Generated by Run-of-River Small Hydropower Plant

The Energy E_{hyd} [kWh] of run-of-river small hydropower plant can be calculated by basing on:

$$E_{hyd}(t) = 24 \cdot \rho \cdot g \cdot Q_T(t) \cdot H_{net} \cdot \eta_T(t) \cdot \eta_G \quad (5)$$

where ρ is the water mass density [kg/m^3], g is the gravity acceleration, Q_T is the daily average turbined flow [m^3/s] of the day t , H_{net} is the net water head [m], η_G and η_T are respectively the efficiencies of electrical generator and turbine. The electrical generator efficiency is about 90% [52]. A Pelton turbine is suitable for Yeripao hydropower plant [53]. The turbine efficiency is expressed in [54] by :

$$\eta_T(t) = \left[a \cdot \left(\frac{Q_T(t)}{Q_{Tr}} \right)^2 + b \cdot \left(\frac{Q_T(t)}{Q_{Tr}} \right) + c \right] \cdot \eta_{Tr} \quad (6)$$

where η_{Tr} and Q_{Tr} are respectively the nominal turbine efficiency and the nominal turbine flow rate, and $\{a, b, c\}$ are coefficients defined in [54].

D. Model of Energy Production Cost of Solar Photovoltaic Plants

Energy production cost of solar photovoltaic plant C_{pv} [€] (7) is computed as the sum of investment cost C_{pvi} [€], maintenance cost C_{pvm} [€] and inverters cost C_{invpv} [€] of solar photovoltaic plant.

$$C_{pv} = C_{pvi} + C_{pvm} + C_{invpv} \quad (7)$$

C_{pvi} is calculated through the formula (8) [55]. C_{pvm} is estimated as 2% of C_{pvi} [56].

$$C_{pvi}[\text{€}] = P_{pvi} \cdot (C_{pv/wp} + C_{pvins/wp}) \quad (8)$$

Where:

$C_{pv/wp}$ and $C_{pvins/wp}$ are the proportional constants associated with the PV acquisition and installation, respectively. They are estimated around US\$ 341/kWp (€ 300.79/kWp) and US\$ 450/kWp (€ 396.94/kWp), respectively [55].

P_{pvi} [kW] is the installed peak power of n_{PV} that is equal to:

$$P_{pvi}[\text{kW}] = n_{PV} \cdot P_{pvu} \quad (9)$$

Where P_{pvu} [kW] is equal the installed peak power of one PV module, equal to 0.280 kW [47], and n_{PV} is considered as decision variable in our study case.

C_{invpv} is calculated through the formula (10) [55].

$$C_{invpv}[\text{€}] = P_{pvi} \cdot C_{inv/wp} \quad (10)$$

Where: $C_{inv/wp}$ is the proportional constant associated with the PV inverters. Its value is estimated around US\$ 71/kWp (€ 62.91/kWp) [55].

E. Model of Energy Production Cost of Run-of-River Small Hydropower Plants.

Energy production cost of run-of-river small hydropower plant C_{hyd} [€] (11) is also sum of the investment cost C_{hydi} [€] and maintenance cost C_{hyd_m} [€] of run-of-river small hydropower plant.

$$C_{hyd} = C_{hydi} + C_{hyd_m} \quad (11)$$

The models proposed in [57] are used to determine C_{hydi} . These models were chosen because they depend not only on net head [m] and output Power [kW], but also on n_{hyd} , which is considered as decision variable in this work. C_{hydm} is estimated as 5% of the investment cost [58].

F. Optimization Problem Formulation

This study concerns the optimal sizing of a run-of-river small hydro-PV hybrid power system for rural electrification. The dual objective functions of the problem are to maximize the total generated energy $E(T)$ and minimize the energy production cost C_T of the system, as shown in (12) and (13), respectively. Q_{Tr} , n_{hyd} , and n_{pv} constitute the design variables of the problem.

Objective 1:

$$E(T) = \max \sum_{t=1}^T [E_{hyd}(t) + E_{pv}(t)] \quad (12)$$

where T is the total number of days (i.e. 731 days) in the time period studied (i.e. two years 2016-2017).

Objective 2:

$$C_T = \min(C_{hyd} + C_{pv}) \quad (13)$$

NSGA-II, proposed in [59], [60], is employed to solve the multi-objective optimization problem raised. The detailed description of the optimization process for hydro-PV hybrid power system is presented by the flowchart in Fig. 6.

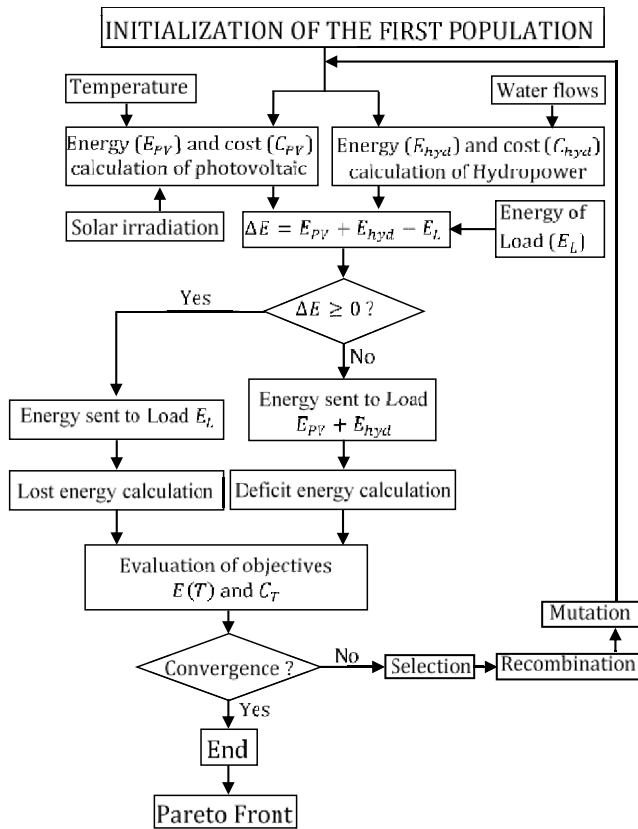


Fig. 6 Proposed optimization process of hydro-PV hybrid system.

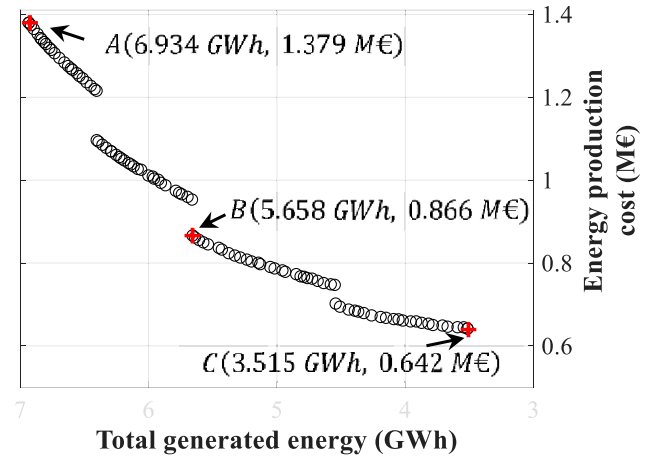


Fig. 7 Pareto front of the case study.

III. RESULTS AND DISCUSSION

In this section, the Pareto front of the case study is presented; followed by the influences of Q_T and n_{hyd} on objective functions.

A. Pareto Front

In multi-objective optimization, a solution is dominant if this solution is better than other solution for at least one objective and is not worse than any objective. The set of all non-dominated solutions of optimization is called the Pareto front. In Fig. 7, the Pareto front presents 100 optimal solutions resulting from the computation of 80 generations. These optimal solutions correspond to the best trade-offs between the total generated energy and the energy production cost of the hydro-PV hybrid power system. Indeed, the energy production cost increases with total generated energy. Minimization of the energy production cost is then contradictory with maximization of total generated energy. Each solution contains optimal decision variables for sizing the PV-hydro hybrid power system. In Fig. 7, solution A provides the highest overall total generated energy and is the most expensive. Likewise, solution C represents the solution which offers the least energy production cost, and the lowest overall total generated energy. Solution B gives intermediate energy production cost and total generated energy.

B. Variation Analysis of Objective Functions as Function of Decision Variables

The influences of hydropower units number and nominal turbine flow rate on total generated energy, energy production cost, and on cost per kWh are illustrated in Figs. 8-10, respectively. These solutions are grouped into four categories according to the number of hydropower units: triangle marker ($n_{hyd} = 1$), cross marker ($n_{hyd} = 2$), square marker ($n_{hyd} = 3$) and circle marker ($n_{hyd} = 4$). For each category, the curve increases with nominal turbine flow rate. These figures show that the category which corresponds to the lowest total generated energies and least energy production costs, is that of which n_{hyd} is equal to one. For n_{hyd} equal to four, the solutions are most expensive and generate the highest total energy. The intermediate solutions are grouped into categories that n_{hyd} is equal to two or three. The variation ranges of nominal turbine flow rate, energy production costs, total generated energies and of cost per kWh are detailed in table I.

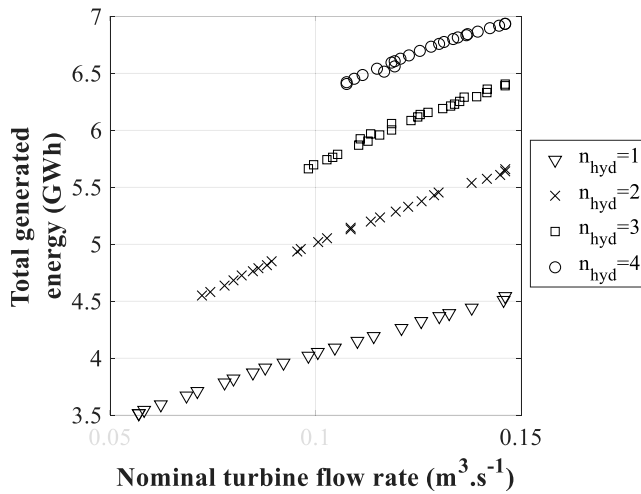


Fig 8 Variation of total generated energy.

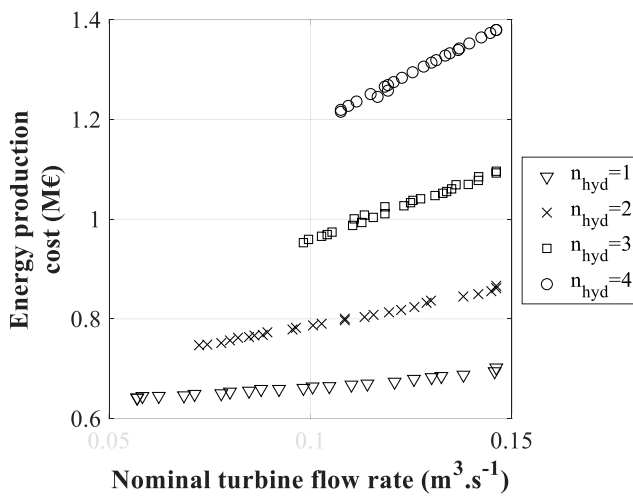


Fig 9 Variation of energy production cost.

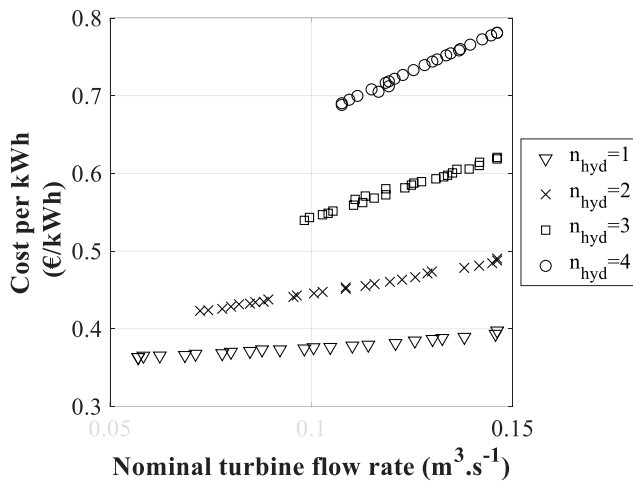


Fig 10 Variation of cost per kWh.

TABLE I VARIATION RANGES OF OPTIMAL SOLUTIONS

	$n_{hyd} = 1$	$n_{hyd} = 2$	$n_{hyd} = 3$	$n_{hyd} = 4$
Number of optimal solutions	23	27	26	24
Nominal turbine flow rate (m^3/s)	[0.057 0.146]	[0.072 0.146]	[0.098 0.146]	[0.108 0.146]
Energy production cost (M€)	[0.642 0.702]	[0.747 0.866]	[0.953 1.093]	[1.215 1.379]
Total generated energy (GWh)	[3.515 4.543]	[4.550 5.658]	[5.662 6.405]	[6.422 6.934]
Cost per kWh (€/kWh)	[0.363 0.398]	[0.423 0.491]	[0.540 0.621]	[0.691 0.781]

IV. CONCLUSION

This study proposed the optimal sizing of run-of-river small hydro-PV hybrid power system by using NSGAI. The total generated energy is maximized while the energy production cost is minimized. The nominal turbine flow rate Q_{Tr} , the number of hydropower units n_{hyd} , and the number of PV modules n_{pv} are used as decision variables in optimization procedure. The developed methodology is applied to hydro and solar resources of Yeripao site in Natitingou, a town located in northwest of Benin. The optimal solutions converge to Pareto front which represents the best trade-offs between total generated energy and energy production cost. The energy production cost increases with the total generated energy. Thus, minimizing the cost of energy production is contradictory with maximizing total generated energy. The influences of Q_T and n_{hyd} on total generated energy, energy production cost and on cost per kWh are also investigated. The results show that the solutions are grouped in four categories according to $n_{hyd} = 1, 2, 3$ or 4 . It is interesting to note that for each category, the total generated energies, energy production costs and cost per kWh increase with nominal turbine flow rate. The category, that $n_{hyd} = 1$, has given the lowest total generated energies, the least energy production costs and costs per kWh. Moreover, the category solutions with $n_{hyd} = 4$ generate the highest total energies but are more expensive. The lowest overall cost per kWh is € 0.363/kWh. This study applied to Yeripao site can be extended to other sites by considering their hydro and solar resources characteristics.

ACKNOWLEDGMENT

The authors would like to thank Governments of France and Benin for funding this research. They thank Société Béninoise de l'Energie Electrique (SBEE), and Solar Energy Services for providing data on hydro and solar resources of Yeripao in Benin.

REFERENCES

- [1] J. Margeta and Z. Glasnovic, "Theoretical settings of photovoltaic-hydro energy system for sustainable energy production," *Sol. Energy*, vol. 86, no. 3, pp. 972–982, 2012 [Online]. Available: <http://dx.doi.org/10.1016/j.solener.2012.01.007>
- [2] P. E. Campana, H. Li, and J. Yan, "Dynamic modelling of a PV pumping system with special consideration on water demand," *Appl. Energy*, vol. 112, pp. 635–645, 2013 [Online]. Available: <http://dx.doi.org/10.1016/j.apenergy.2012.12.073>
- [3] B. François, B. Hingray, M. Borga, D. Zoccatelli, C. Brown, and J. D. Creutin, "Impact of climate change on combined solar and run-of-river power in Northern Italy," *Energies*, vol. 11, no. 2, pp. 1–22, 2018.

- [4] M. Shabani and J. Mahmoudimehr, "Techno-economic role of PV tracking technology in a hybrid PV-hydroelectric standalone power system," *Appl. Energy*, vol. 212, pp. 84–108, 2018 [Online]. Available: <https://doi.org/10.1016/j.apenergy.2017.12.030>
- [5] M. Aza-Gnandji *et al.*, "Complementarity between Solar and Wind Energy Potentials in Benin Republic," *Adv. Eng. Forum*, vol. 28, pp. 128–138, 2018.
- [6] C. M. Hong and C. H. Chen, "Intelligent control of a grid-connected wind-photovoltaic hybrid power systems," *Int. J. Electr. Power Energy Syst.*, vol. 55, pp. 554–561, 2014 [Online]. Available: <http://dx.doi.org/10.1016/j.ijepes.2013.10.024>
- [7] A. A. S. de la Nieta, J. Contreras, J. I. Muoz, and J. P. S. Catalo, "Optimal wind reversible hydro offering strategies for midterm planning," *IEEE Trans. Sustain. Energy*, vol. 6, no. 4, pp. 1356–1366, 2015.
- [8] A. A. S. de la Nieta, J. Contreras, and J. P. S. Catalo, "Optimal Single Wind Hydro-Pump Storage Bidding in Day-Ahead Markets Including Bilateral Contracts," *IEEE Trans. Sustain. Energy*, vol. 7, no. 3, pp. 1284–1294, 2016.
- [9] J. Schmidt, R. Cancelli, and A. O. Pereira, "An optimal mix of solar PV, wind and hydro power for a low-carbon electricity supply in Brazil," *Renew. Energy*, vol. 85, no. 2016, pp. 137–147, 2016 [Online]. Available: <http://dx.doi.org/10.1016/j.renene.2015.06.010>
- [10] X. Wang, Y. Mei, Y. Kong, Y. Lin, and H. Wang, "Improved multi-objective model and analysis of the coordinated operation of a hydro-wind-photovoltaic system," *Energy*, vol. 134, pp. 813–839, 2017 [Online]. Available: <http://dx.doi.org/10.1016/j.energy.2017.06.047>
- [11] D. Kumar Lal, B. Bhusan Dash, and A. K. Akella, "Optimization of PV / Wind / Micro-Hydro / Diesel Hybrid Power System in HOMER for the Study Area," *Int. J. Electr. Eng. Informatics*, vol. 3, no. 3, pp. 307–325, 2011.
- [12] A. V. Anayochukwu, "Optimal control of PV/wind/hydro-diesel hybrid power generation system for off-grid macro base transmitter station site," *Electron. J. Energy Environ.*, vol. 1, no. 2, pp. 37–55, 2013.
- [13] W. Yang, P. Norrlund, J. Bladh, J. Yang, and U. Lundin, "Hydraulic damping mechanism of low frequency oscillations in power systems: Quantitative analysis using a nonlinear model of hydropower plants," *Appl. Energy*, vol. 212, pp. 1138–1152, 2018 [Online]. Available: <https://doi.org/10.1016/j.apenergy.2018.01.002>
- [14] A. Beluco *et al.*, "A method to evaluate the effect of complementarity in time between hydro and solar energy on the performance of hybrid hydro PV generating plants," *Renew. Energy*, vol. 45, pp. 24–30, 2012 [Online]. Available: <http://dx.doi.org/10.1016/j.renene.2012.01.096>
- [15] B. François, D. Zoccatelli, and M. Borga, "Assessing small hydro/solar power complementarity in ungauged mountainous areas: A crash test study for hydrological prediction methods," *Energy*, vol. 127, pp. 716–729, 2017 [Online]. Available: <http://dx.doi.org/10.1016/j.energy.2017.03.090>
- [16] I. Kougiass, S. Szabó, F. Monforti-Ferrario, T. Huld, and K. Bódis, "A methodology for optimization of the complementarity between small-hydropower plants and solar PV systems," *Renew. Energy*, vol. 87, pp. 1023–1030, 2016.
- [17] B. François, M. Borga, J. D. Creutin, B. Hingray, D. Raynaud, and J. F. Sauterleute, "Complementarity between solar and hydro power: Sensitivity study to climate characteristics in Northern-Italy," *Renew. Energy*, vol. 86, pp. 543–553, 2016 [Online]. Available: <http://dx.doi.org/10.1016/j.renene.2015.08.044>
- [18] H. Li, P. Liu, S. Guo, B. Ming, L. Cheng, and Z. Yang, "Long-term complementary operation of a large-scale hydro-photovoltaic hybrid power plant using explicit stochastic optimization," *Appl. Energy*, vol. 238, pp. 863–875, 2019.
- [19] W. C. Sheng *et al.*, "Research on control strategies of small-hydro/PV hybrid power system," *Sustain. Power Gener. Supply, 2009. SUPERGEN'09. Int. Conf. on IEEE*, vol. 1, pp. 1–5, 2009 [Online]. Available: http://ieeexplore.ieee.org/xpls/abs_all.jsp?arnumber=5348119
- [20] Z. Yang, C. Wu, H. Liao, Y. Wang, and H. Wang, "Research on hydro/photovoltaic hybrid generating system," in *2010 International Conference on Power System Technology: Technological*, 2010, pp. 1–6.
- [21] J. H. Zhou *et al.*, "Stability Simulation of a MW-Scale PV-Small Hydro Autonomous Hybrid System," in *IEEE*, 2013, pp. 21–25.
- [22] S. Meshram, G. Agnihotri, and S. Gupta, "Modeling of Grid connected DC linked PV/Hydro Hybrid System," *Electr. Electron. Eng. An Int. J.*, vol. 2, no. 3, 2013.
- [23] S. Meshram, G. Agnihotri, and S. Gupta, "Performance analysis of grid integrated hydro and solar based hybrid systems," *Adv. Power Electron.*, vol. 2013, 2013.
- [24] S. Meshram, G. Agnihotri, and S. Gupta, "Power Management Strategy for Active Power Sharing in Hydro / PV / Battery Hybrid Energy System," *Chinese J. Eng.*, vol. 2013, p. 7, 2013.
- [25] F. Wei, S. Kai, Y. Guan, and Y. Wang, "A novel frequency restoring strategy of hydro-PV hybrid microgrid," in *2014 International Power Electronics and Application Conference and Exposition*, 2014, pp. 348–353.
- [26] M. Rezkallah, S. Sharma, A. Chandra, and B. Singh, "Hybrid standalone power generation system using hydro-PV-battery for residential green buildings," in *IECON 2015 - 41st Annual Conference of the IEEE Industrial Electronics Society*, 2015, pp. 003708–003713.
- [27] Y. An *et al.*, "Theories and methodology of complementary hydro/photovoltaic operation: Applications to short-term scheduling," *J. Renew. Sustain. Energy*, vol. 7, p. 063133, 2015 [Online]. Available: <http://dx.doi.org/10.1063/1.4939056>
- [28] F.-F. Li and J. Qiu, "Multi-objective optimization for integrated hydro-photovoltaic power system," *Appl. Energy*, vol. 167, no. May 2016, pp. 377–384, 2016 [Online]. Available: <http://dx.doi.org/10.1016/j.apenergy.2015.09.018>
- [29] B. Jena and A. Choudhury, "Voltage and frequency stabilisation in a micro-hydro-PV based hybrid microgrid using FLC based STATCOM equipped with BESS," in *2017 International Conference on Circuit, Power and Computing Technologies (ICCPCT)*, 2017, pp. 1–7.
- [30] J. Jurasz and B. Ciapała, "Integrating photovoltaics into energy systems by using a run-off-river power plant with pondage to smooth energy exchange with the power grid," *Appl. Energy*, vol. 198, pp. 21–35, 2017 [Online]. Available: <http://dx.doi.org/10.1016/j.apenergy.2017.04.042>
- [31] Z. Yang, P. Liu, L. Cheng, H. Wang, B. Ming, and W. Gong, "Deriving operating rules for a large-scale hydro-photovoltaic power system using implicit stochastic optimization," *J. Clean. Prod.*, vol. 195, pp. 562–572, 2018.
- [32] K. K. Reddy, "Optimal Modeling of Grid Connected DC Coupled PV / Hydro Hybrid Power System," *Elixir Int. Journal, Electr. Eng.*, vol. 121, pp. 51530–51534, 2018.
- [33] S. Das and A. K. Akella, "A Control Strategy for Power Management of an Isolated Micro Hydro-PV-Battery Hybrid Energy System," in *2018 4th International Conference on Electrical Energy Systems (ICEES)*, 2018, pp. 397–401.
- [34] L. Liu, Q. Sun, Y. Wang, Y. Liu, and R. Wennersten, "Research on Short-term Optimization for Integrated Hydro-PV Power System Based on Genetic Algorithm," *Energy Procedia*, vol. 152, pp. 1097–1102, 2018 [Online]. Available: <https://linkinghub.elsevier.com/retrieve/pii/S1876610218306763>
- [35] B. Ming, P. Liu, L. Cheng, Y. Zhou, and X. Wang, "Optimal daily generation scheduling of large hydro-photovoltaic hybrid power plants," *Energy Convers. Manag.*, vol. 171, pp. 528–540, 2018.
- [36] Z. Glasnovic and J. Margeta, "Optimal Sizing of Photovoltaic-hydro Power Plant," *Prog. Photovolt Res. Appl.*, vol. 17, no. June, pp. 115–125, 2009.
- [37] W. Fang, Q. Huang, S. Huang, J. Yang, E. Meng, and Y. Li, "Optimal sizing of utility-scale photovoltaic power generation complementarily operating with hydropower: A case study of the world's largest hydro-photovoltaic plant," *Energy Convers. Manag.*, vol. 136, pp. 161–172, 2017 [Online]. Available: <http://dx.doi.org/10.1016/j.enconman.2017.01.012>
- [38] B. Ming, P. Liu, S. Guo, X. Zhang, M. Feng, and X. Wang, "Optimizing utility-scale photovoltaic power generation for integration into a hydropower reservoir by incorporating long-and short-term operational decisions," *Appl. Energy*, vol. 204, pp. 432–445, 2017 [Online]. Available: <http://dx.doi.org/10.1016/j.apenergy.2017.07.046>
- [39] J. Mahmoudimehr and M. Shabani, "Optimal Design of Hybrid Photovoltaic-Hydroelectric Standalone Energy System for North

- and South of Iran,” *Renew. Energy*, vol. 115, pp. 238–251, 2018.
- [40] S. Kumar, T. Kaur, M. K. Arora, and S. Upadhyay, “Resource estimation and sizing optimization of PV/micro hydro-based hybrid energy system in rural area of Western Himalayan Himachal Pradesh in India,” *Energy Sources, Part A Recover. Util. Environ. Eff.*, pp. 1–13, 2019 [Online]. Available: <https://doi.org/10.1080/15567036.2019.1576075>
- [41] N. M. Silvério, R. M. Barros, G. L. T. Filho, M. Redón-Santafé, I. F. S. dos Santos, and V. E. de Mello Valério, “Use of floating PV plants for coordinated operation with hydropower plants: Case study of the hydroelectric plants of the São Francisco River basin,” *Energy Convers. Manag.*, vol. 171, pp. 339–349, 2018 [Online]. Available: <https://doi.org/10.1016/j.enconman.2018.05.095>
- [42] F.-F. Li, J. Qiu, and J.-H. Wei, “Multiobjective optimization for hydro-photovoltaic hybrid power system considering both energy generation and energy consumption,” *Energy Sci. Eng.*, vol. 6, no. 5, pp. 362–370, 2018 [Online]. Available: <http://doi.wiley.com/10.1002/ese3.202>
- [43] B. Ming *et al.*, “Robust hydroelectric unit commitment considering integration of large-scale photovoltaic power: A case study in China,” *Appl. Energy*, vol. 228, pp. 1341–1352, 2018.
- [44] M. Veilleux and T. Clausen, “RAPPORT de faisabilité final SUR sur : - La remise en état et extension de la centrale hydroélectrique (HPP) de Yeripao - Les concepts de maintenance pour de l’énergie centrales hydroélectriques de la SBEE.” Cotonou / Bénin, 2015.
- [45] Site of Solar radiation Data (SoDa), “Solar Energy Services for Professionals,” 2019. [Online]. Available: <http://www.soda-pro.com/fr/home;jsessionid=8906CCF20A49F61CEDFD22717C014620>
- [46] C. Blodgett, P. Dauenhauer, H. Louie, and L. Kickham, “Accuracy of energy-use surveys in predicting rural mini-grid user consumption,” *Energy Sustain. Dev.*, vol. 41, pp. 88–105, 2017 [Online]. Available: <https://doi.org/10.1016/j.esd.2017.08.002>
- [47] Site de Photon Solar Energy-Germany, *PHOTON SOLAR SC-LINE SC-280P*. 2019.
- [48] Macarena Jiménez Sánchez, *Diseño de planta solar fotovoltaica de 20mw en california y conexión a la red de distribución*. Madrid, 2012.
- [49] A. O. Benelkadi, A. Kaabeche, and Y. Bakelli, “Etude de faisabilité technico-économique des centrales photovoltaïques en Algérie,” *Rev. des Energies Renouvelables*, vol. 21, no. 2, pp. 181–198, 2018.
- [50] X. Yan, D. Abbes, and B. Francois, “Uncertainty analysis for day ahead power reserve quantification in an urban microgrid including PV generators,” *Renew. Energy*, vol. 106, pp. 288–297, 2017 [Online]. Available: <http://dx.doi.org/10.1016/j.renene.2017.01.022>
- [51] Site de DATEANDTIME.INFO, “Le lever et le coucher du Soleil, la durée du jour à Natitingou, Bénin.” [Online]. Available: <http://dateandtime.info/fr/citysunrisesunset.php?id=2392601&month=1&year=2016>
- [52] B. A. Nasir, “Design of Micro - Hydro - Electric Power Station,” *Int. J. Eng. Adv. Technol.*, vol. 2, no. 5, pp. 39 – 47, 2013.
- [53] A. H. J. Hounnou, F. Dubas, F. Fifatin, D. Chamagne, and A. Vianou, “Multi-Objective Optimization of Run-of-River Small-Hydropower Plants Considering Both Investment Cost and Annual Energy Generation,” *World Acad. Sci. Eng. Technol. Int. J. Energy Power Eng.*, vol. 13, no. 1, pp. 17–21, 2019.
- [54] N. G. Voros, C. T. Kiranoudis, and Z. B. Maroulis, “Short-cut design of small hydroelectric plants,” *Renew. Energy*, vol. 19, no. 4, pp. 545–563, 2000.
- [55] C. D. Rodriguez-Gallegos *et al.*, “A Siting and Sizing Optimization Approach for PV-Battery-Diesel Hybrid Systems,” *IEEE Trans. Ind. Appl.*, vol. 54, no. 3, pp. 2637–2645, 2018.
- [56] E. Eimhjellen, “Optimal design of photovoltaic power plants,” Master thesis, University of Bergen, 2018.
- [57] S. K. Singal and R. P. Saini, “Cost analysis of low-head dam-toe small hydropower plants based on number of generating units,” *Energy Sustain. Dev.*, vol. 12, no. 3, pp. 55–60, 2008 [Online]. Available: [http://dx.doi.org/10.1016/S0973-0826\(08\)60439-1](http://dx.doi.org/10.1016/S0973-0826(08)60439-1)
- [58] O. P. Rahi, A. K. Chandel, and M. G. Sharma, “Optimization of Hydro Power Plant Design by Particle Swarm Optimization (PSO),” *Procedia Eng.*, vol. 30, pp. 418–425, 2012 [Online]. Available: <http://dx.doi.org/10.1016/j.proeng.2012.01.880>
- [59] K. Deb, A. Pratap, S. Agarwal, and T. Meyarivan, “A fast and elitist multiobjective genetic algorithm: NSGA-II,” *IEEE Trans. Evol. Comput.*, vol. 6, no. 2, pp. 182–197, 2002.
- [60] K. Deb and A. Kumar, “Light beam search based multi-objective optimization using evolutionary algorithms,” *2007 IEEE Congr. Evol. Comput. CEC 2007*, pp. 2125–2132, 2006.